


TOMBIGBEE ELECTRIC COOPERATIVE

MAST TYPE SERVICE ASSEMBLY GUIDE

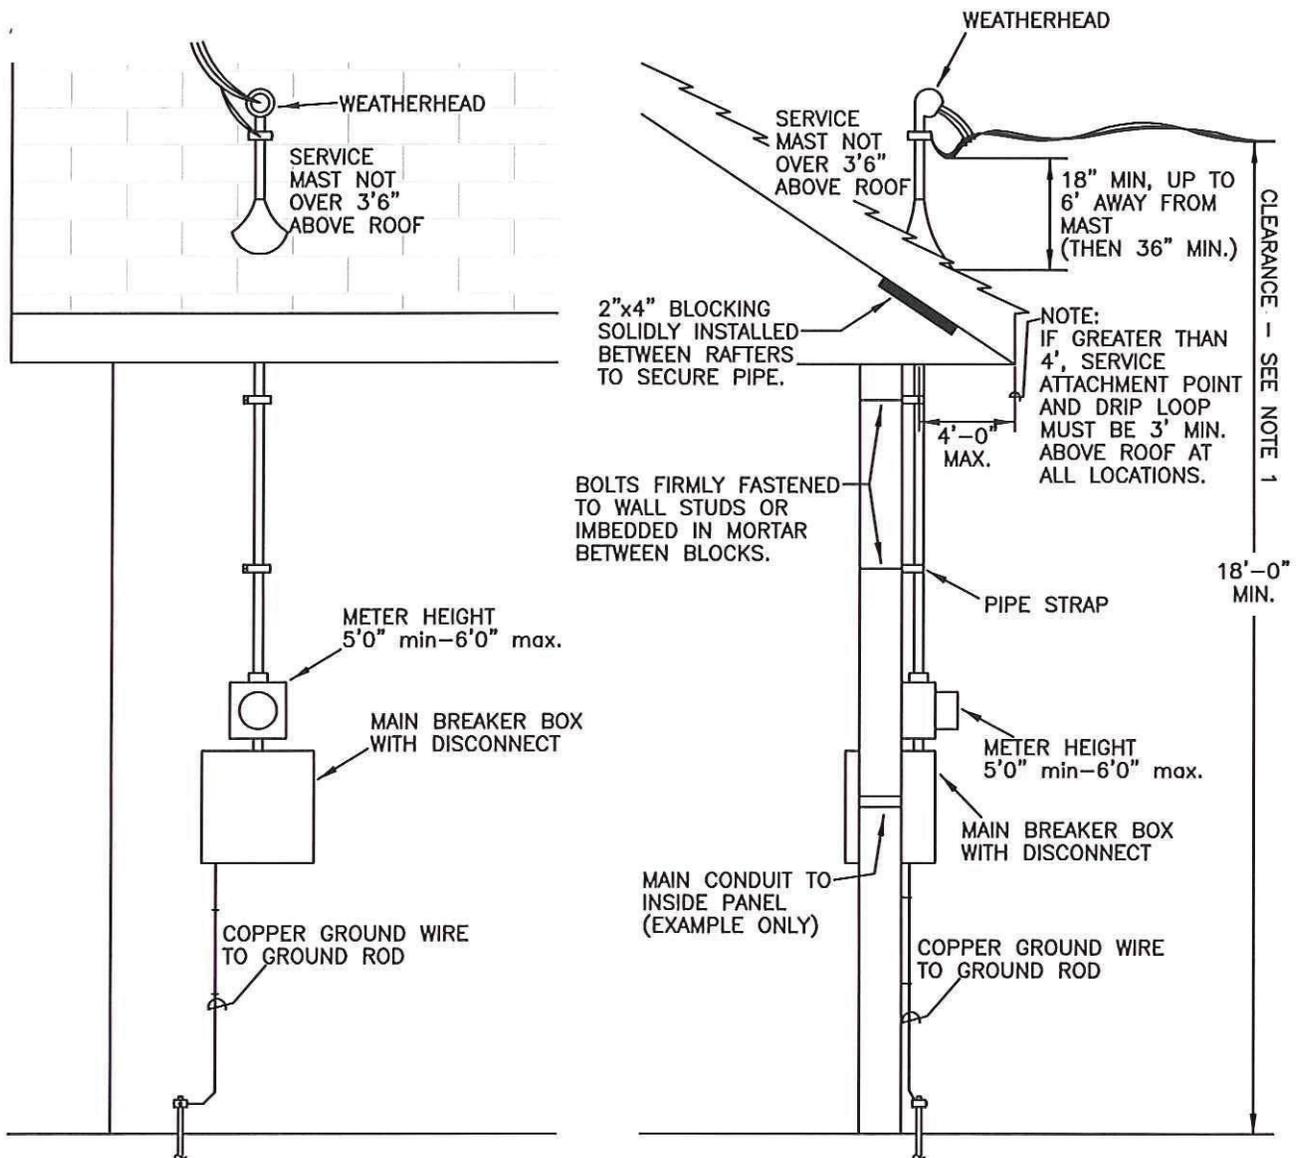

NOTES:

1. ALL CLEARANCES TO BE IN CONFORMANCE TO THE MOST STRINGENT REQUIREMENTS OF THE CURRENT EDITION OF EITHER THE NESC, NEC, OR OTHER CODES OF GOVERNMENTAL OR REGULATING AUTHORITIES AS APPLICABLE.
2. IF LENGTH OF CONDUIT EXCEEDS 10', COUPLING IS PERMITTED ON END ADJACENT TO METER.